

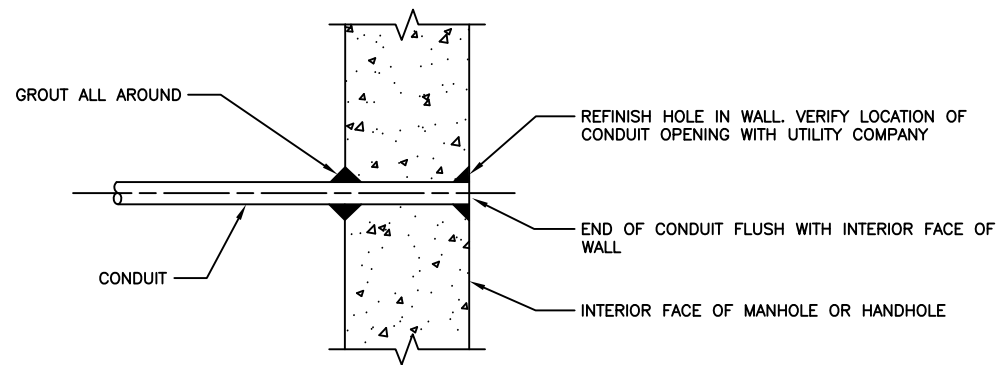


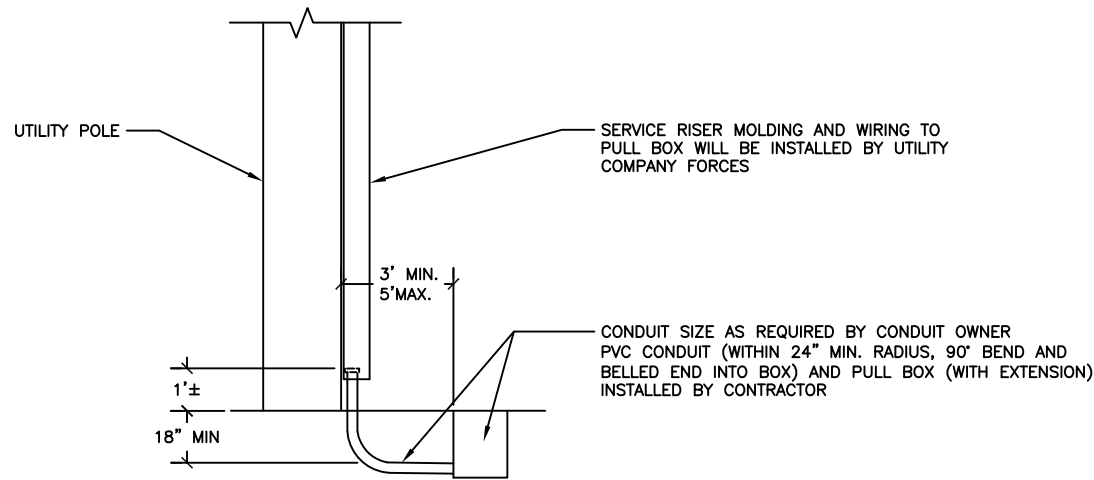

INSTALLATION OF SERVICE CONDUITS IN OR ON  
UTILITY OWNED WOOD POLES, MANHOLES & HANDHOLES

SHEET NOTES:

1. CONDUITS TO UTILITY COMPANY MANHOLES AND HANDHOLES SHALL BE 1 1/2" TRADE SIZE, UNLESS OTHERWISE NOTED.
2. THE LOCATIONS OF CONDUITS IN OR ON PACIFIC GAS AND ELECTRIC COMPANY OWNED FACILITY WILL BE DETERMINED BY A REPRESENTATIVE OF THE COMPANY. ALL WORK IN OR ON THE COMPANY OWNED FACILITY SHALL BE DONE ONLY IN THE PRESENCE OF A REPRESENTATIVE OF THE COMPANY UNLESS OTHERWISE DIRECTED BY SAID REPRESENTATIVE.
3. THE CONTRACTOR SHALL FURNISH AND INSTALL A GROUND ROD FOR EACH SERVICE INSTALLATION. GROUND ROD SHALL BE COPPERCLAD STEEL, 5/8" x 10 FT. LONG.
4. SERVICE WIRING SHALL BE OF SUFFICIENT LENGTH TO REACH THE LOCATION OF SERVICE CONNECTIONS WITHIN OR ON THE UTILITY OWNED FACILITY AS DIRECTED BY A REPRESENTATIVE OF THE UTILITY COMPANY.
5. THE PVC CONDUIT FURNISHED AND INSTALLED FOR WOOD POLE SERVICE SHALL BE CONSIDERED AS INCIDENTAL WORK.
6. SFPUC STREETLIGHT CONDUITS SHOULD BE 1 1/2" RGS AND 2" PVC SCHEDULE 80.

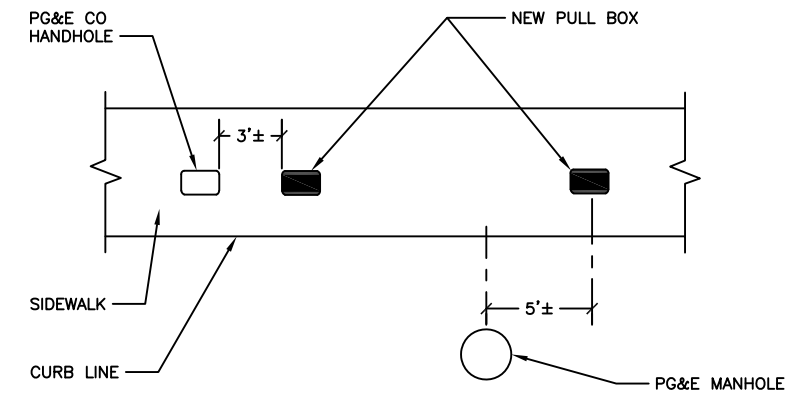

TYPICAL LOCATIONS OF PULL BOXES  
NEAR SERVICE FACILITIES

THIS STANDARD PLAN WAS DEVELOPED FOR USE ON PUBLIC UTILITIES COMMISSION PROJECTS IN THE CITY AND COUNTY OF SAN FRANCISCO, AND SHALL NOT BE USED WITHOUT CONSULTING A REGISTERED PROFESSIONAL ENGINEER. SFPUC/POWER RESERVES THE RIGHT TO MAKE REVISIONS TO THIS STANDARD PLAN AT ANYTIME.

STANDARD PLANS  
ELECTRICAL  
SERVICE CONDUITS IN OR ON  
UTILITY OWNED WOOD POLES,  
MANHOLES AND HANDHOLES

| TABLE OF REVISIONS                                 |  |  |  |  |             |
|----------------------------------------------------|--|--|--|--|-------------|
| THIS DRAWING WAS LAST TOUCHED ON 20230629 - 8:18AM |  |  |  |  |             |
|                                                    |  |  |  |  | APP         |
|                                                    |  |  |  |  | BY          |
|                                                    |  |  |  |  | REV         |
|                                                    |  |  |  |  | DATE        |
|                                                    |  |  |  |  | DESCRIPTION |

SFPUC - POWER  
ENTERPRISE  
ENGINEERING: STREETLIGHTS



CITY AND COUNTY OF  
SAN FRANCISCO

CONSULTANTS: OTHER AGENCIES

DATE: 7/1/2023  
DESIGNED: CCSF  
DRAWN: DG  
CHECKED: RH  
PROJ ENGR: -  
SCALE: NOT TO SCALE

SHEET NAME  
PE2656.06

REVISION NUMBER  
1.0